

Reference: **TB 0192 (08/2025)**

Technical Bulletin

Installation: 5800i AW E (wall hung unit) clearances

REDUCTION TO CLEARANCES OF THE INDOOR UNIT 5800i AW E

There has been a reduction in clearances for the 5800i heatpump wall hung indoor unit. Please see below in Fig1 the current installation manual clearances followed by the new allowable clearances in Fig 2 and Fig 3. Be aware when reducing certain clearances there may be additional information to abide by.

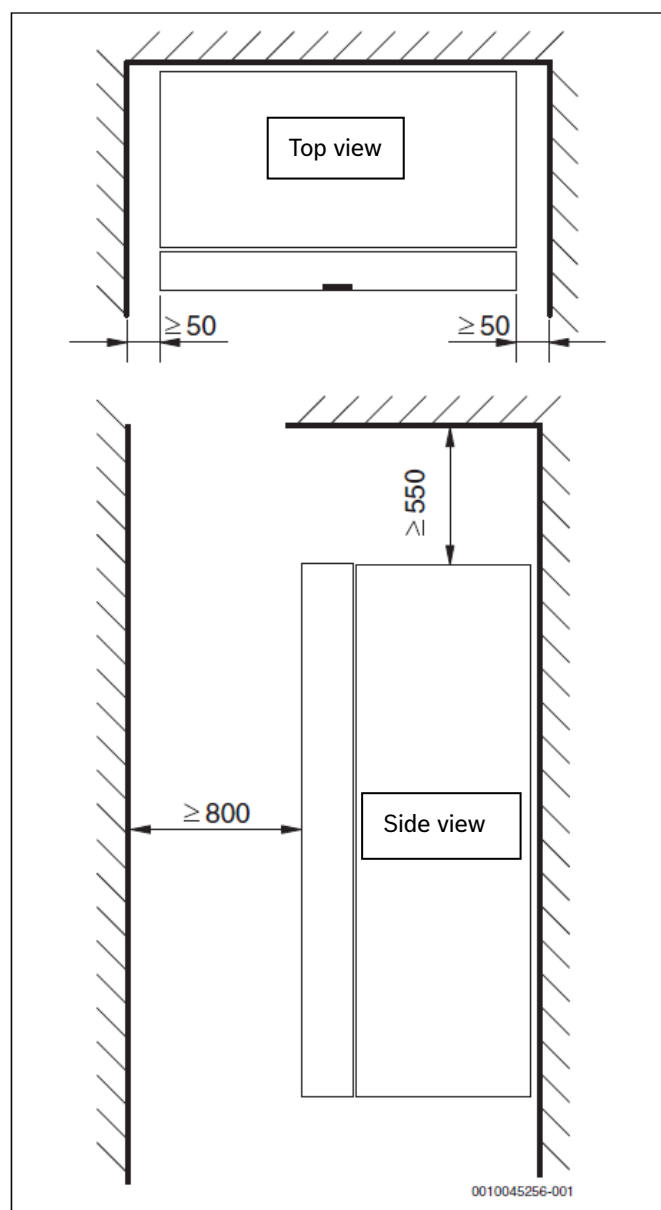


Fig 1. Existing clearances

Whilst it is always our intention to fully assist, it is essential to recognise that all information given by the company in response to an enquiry of any nature is provided in good faith and based upon the information provided with the enquiry. We recommend that advice should always be checked with your installer or contract partner. Consequently, the company cannot be held responsible for any liability relating to the use or repetition of such information or part thereof. In addition, whilst making every reasonable effort to monitor the performance and quality of our supply, installation and service network, we do not accept responsibility for the workmanship or operation of any third party company that the company may have promoted either in conversation, e-mail, or other communication. Similarly, the views and opinions expressed in communication with individuals within the company may not reflect that of the business as a whole.

For all issued technical bulletins, visit the Worcester Bosch website at: www.worcester-bosch.co.uk/tb or www.worcester-bosch.ie/tb

Reference: **TB 0192 (08/2025)**

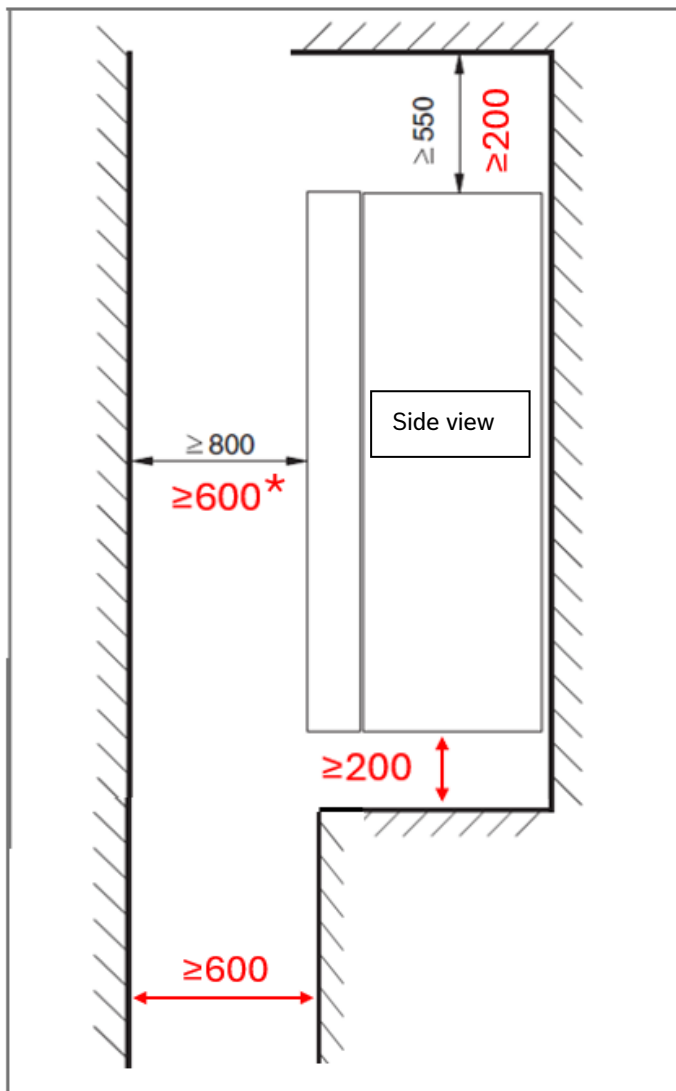


Fig 2. New clearances*

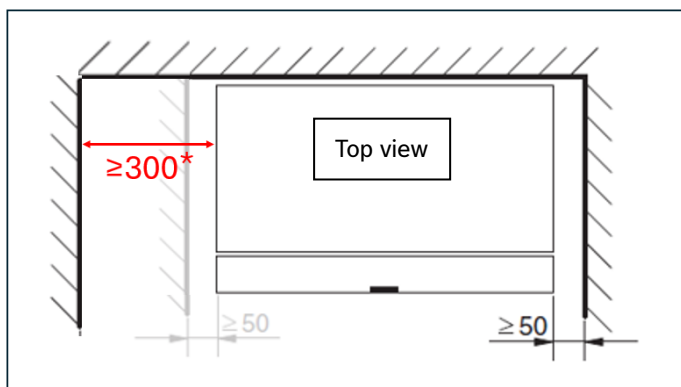


Fig 3. New clearances*

* if the front clearance has been reduced from 800mm to 600mm, then at least 300mm clearance is required on left hand side.

- The bottom of the appliance case must be between 1000mm and 1500mm from the floor.
- There must be at least 50mm clear space to either the left hand or right hand side of the appliance. (Fig 1.)
- There must be at least 200mm clear space to any object which is sited below the appliance. (Fig 2.)
- There must be 200mm clearance above the appliance. (Fig 2.)
- There must be at least 600mm* clearance in front of the appliance to floor level. Anything which is sited below the appliance must not protrude into this clear space. (Fig 2.)
- 300mm required on left hand side should the front access be reduced from 800mm and no less than 600mm (Fig 3.)

Whilst it is always our intention to fully assist, it is essential to recognise that all information given by the company in response to an enquiry of any nature is provided in good faith and based upon the information provided with the enquiry. We recommend that advice should always be checked with your installer or contract partner. Consequently, the company cannot be held responsible for any liability relating to the use or repetition of such information or part thereof. In addition, whilst making every reasonable effort to monitor the performance and quality of our supply, installation and service network, we do not accept responsibility for the workmanship or operation of any third party company that the company may have promoted either in conversation, e-mail, or other communication. Similarly, the views and opinions expressed in communication with individuals within the company may not reflect that of the business as a whole.

For all issued technical bulletins, visit the Worcester Bosch website at: www.worcester-bosch.co.uk/tb or www.worcester-bosch.ie/tb